
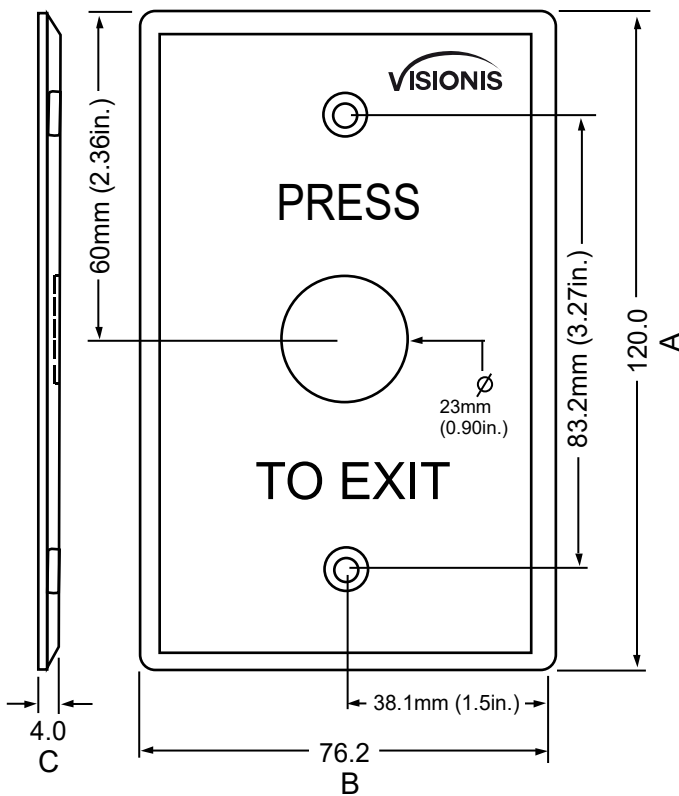


INSTALLATION MANUAL

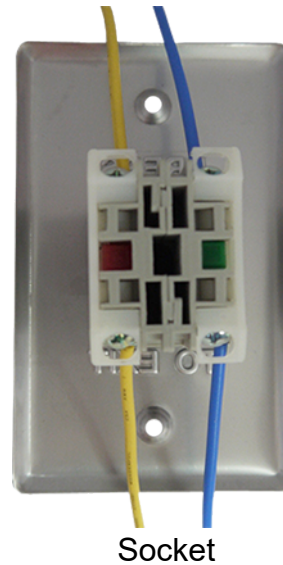

Length (A): 120.0mm (4.72in.)

Width (B): 76.20mm (3.0in.)

Depth (C): 4.0mm (0.15in.)



Disclaimer: VISIONIS reserve the right to go ahead with any modifications of models or features or price without forewarning. All the information and specifications stated in this document are current at the time of publication. Attention: We are not responsible for the improper installation of this kit. If you are not handy with electrical equipment you should contact a professional electrician. You will also need to check with your local Fire authority to see if you need anything else to comply with local Fire Codes. We are not responsible for any damage or fees that can occur.




sales@visionistech.com



www.visionistech.com

Push to Exit Button Wiring Diagram

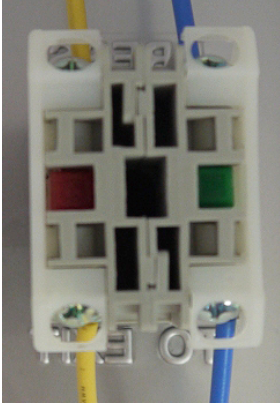

Wire Color

NO: Blue/Blue

NC: Yellow/Yellow

- (1) Push-button dry contact rating: AC 125V 6A or AC 300V 3A. For safe operations, do not exceed the ratings above.
- (2) For normally open requirements, connect wires to N.O dry contact of the BUTTON.
- (3) For normally close requirements, connect wires to N.C dry contact of the BUTTON.

