



**IMPORTANT:**

The battery in this unit may not be fully charged. After electricity is connected to the unit, let the battery charge for at least 24 hours. Normal operation of this unit should then take effect (when applicable). To check, press the push-to-test switch, the light inside the unit should then turn on.

**IMPORTANT SAFEGUARDS**

When using electrical equipment, basic safety precautions should always be followed including the following:


**READ AND FOLLOW ALL SAFETY INSTRUCTIONS**

- Do not use outdoors.
- Do not mount near gas or electric heaters.
- Equipment should be mounted in locations and at heights where it will not be subject to tampering by unauthorized personnel.
- The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.
- Do not use this equipment for other than its intended use.
- Before wiring to power supply, turn off electricity at fuse or circuit breaker.
- Consult local building code for approved wiring and installation.
- Installation and servicing should be performed by qualified personnel.

**SAVE THESE INSTRUCTIONS!**

**INSTALLATION (J-BOX MOUNTING):**

1. Feed fixture leads through back plate and connect AC power supply (Fig A).
2. Connect wires through J-Box. Mount back plate on J-Box and secure with screws.
3. Connect battery only after continuous AC power can be provided to the unit (Fig B).
4. Align snaps and push housing directly onto main bottom case (Fig C). Apply continuous AC power and press "TEST" button to check light.

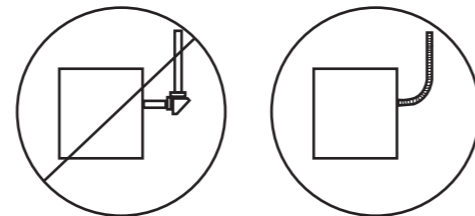

**FLEXIBLE CONDUIT ONLY**

**INSTALLATION CONDUIT:**

1. Secure back plate to wall surface. Route wires through hole in conduit flange and make conduit connection.
2. Connect battery only after continuous AC power can be provided to the unit (Fig B).
3. Align snaps and push housing directly onto back plate (Fig C). Apply continuous AC power and press "TEST" button to check light.



Fig. A (J-Box)




Fig. B

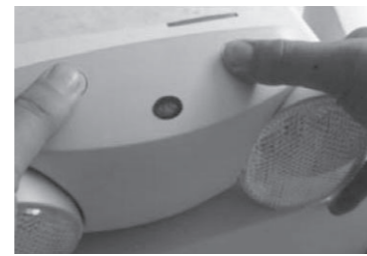


Fig. C

**WARNING**

Unused wires must be capped using enclosed wire nuts.

**OPERATION:**

1. During an electrical power failure, the lamps will automatically come on for a minimum of 90 minutes.
2. To test, depress the "TEST" switch. The emergency lamps will illuminate. When the switch is released, the lamps will go off.

**WIRING DIAGRAM:**

